

# CoolMaster Programmers Reference Manual (PRM)

---



**CoolMaster**  
Interface Adapter  
for VRV, VRF  
Air Conditioning Systems



Cool Master 1000D  
Cool Master 2000S  
Cool Master 3000T  
Cool Master 4000M

# Table of Contents


Foreword		0
<b>Part I RS232 Interface</b>		<b>3</b>
1 Mechanical and Electrical Specification.....		3
2 Port Settings.....		4
<b>Part II General Protocol Definitions</b>		<b>5</b>
1 Message format.....		5
2 Indoor Unit Addressing.....		5
<b>Part III Commands Reference</b>		<b>7</b>
1 Cool Master Commands.....		7
alloff	.....	7
allon	.....	7
boot	.....	8
cool	.....	8
dry	.....	8
heat	.....	9
fan	.....	9
filt	.....	10
fspeed	.....	10
off	.....	10
on	.....	11
set	.....	11
simul	.....	12
stat	.....	13
stat2	.....	13
stat3	.....	14
swing	.....	15
temp	.....	16
<b>Part IV Firmware Update</b>		<b>17</b>
1 Entering bootloader mode.....		17
2 Firmware Download.....		17
3 Reboot	.....	18

# 1 RS232 Interface

## 1.1 Mechanical and Electrical Specification


RS232 Interface connector used in Cool Master is D-Type 9-pin DB9 female connector.

Cool Master DB9 Connector front view

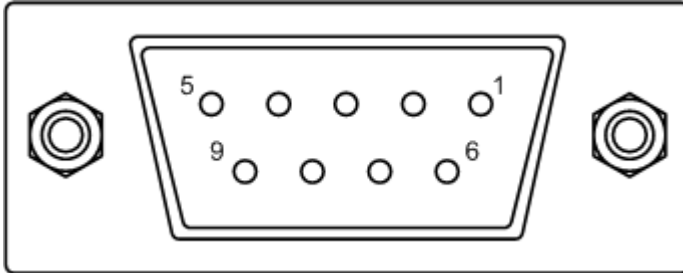

DB9 Pin	Signal Level	Description
2	±12V	TxD (Data from Cool Master)
3	±12V	RxD (Data to Cool Master)
5	GND	Ground

Connecting Cool Master to Home Automation Equipment

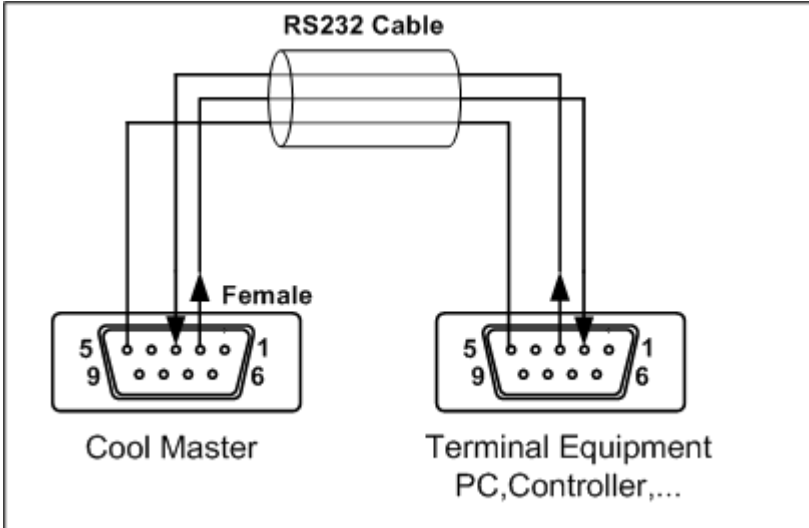


According to RS232 specification cable length should not exceed 25m. RS232 Cable supplied with Cool Master is 1.5m length suitable for direct connection to PC RS232 serial port.

## 1.2 Port Settings

For proper communication with Cool Master RS232 Port should be configured with following parameters

Baud Rate	9600
Data Bits	8
Parity Control	None
Stop Bits	1
Flow Control	None

Below is an example of COM port setup in HyperTerminal application

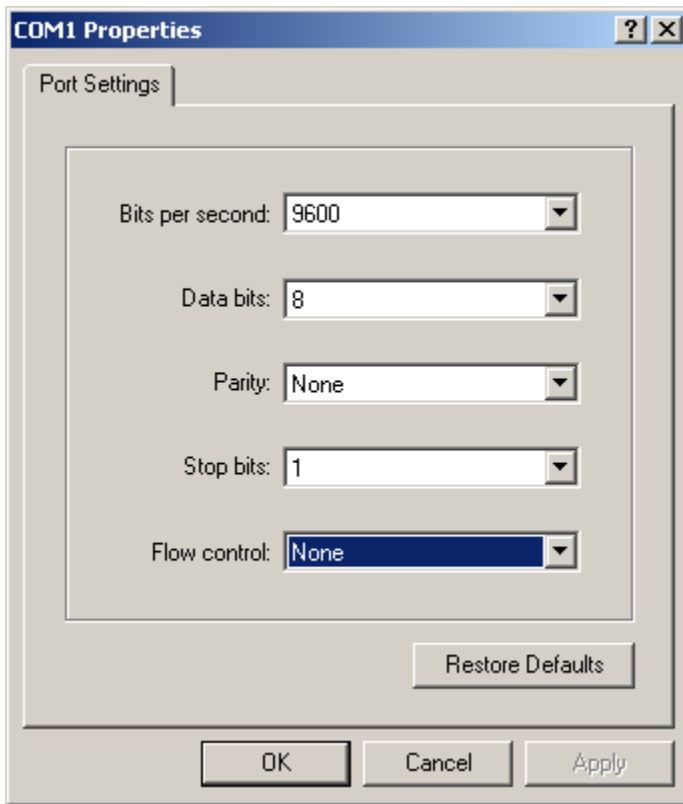



## 2 General Protocol Definitions

### 2.1 Message format

Communication between PC or Home Automation Controller and CoolMaster via RS232 interface is based on text messages. Communication example is shown below

>stat 101	command	PC to CoolMaster
101 ON 27C 00,00C Auto Dry OK	response	CoolMaster to PC
OK	exit code	
>	prompt	

Command message sent to CoolMaster must be terminated by CR (carriage return 0x0D) LF (line feed 0x0A) sequence or a single CR character. Messages from CoolMaster (except prompt character) are terminated by CR LF. Commands are case sensitive and should not contain leading or trailing spaces. The only separator between command name and command parameter(s) is space character.

In case of wrong command CoolMaster response can be one of the following strings:

Unknown command	Unrecognized command name
Bad parameters	Command has missing or wrong parameters

If command was executed CoolMaster will return optional response and exit code. Detailed information is provided in topics describing specific commands.

### 2.2 Indoor Unit Addressing

To address specific indoor unit in CoolMaster command the UID parameter is used. UID format is three digits. First digit can be hexadecimal in range 1-9 or A-F to represent system numbers 1 to 15 correspondingly.

1	2	3
System Number 0-9, A-F	Unit Number in System 00-99	

- For CoolMaster 4000M System Number must be 0, Unit Number must be 01-50
- For CoolMaster 1000D System Number must be in range 1-4
- For CoolMaster 2000S and 3000T System Number should not be 0

UID reflects the indoor unit Centralized Address. For proper operation of Cool Master all indoor units have to be given Centralized Address (depending on specific AC system type this can be done automatically by system or has to be done manually by integrator). You should refer to specific AC system manuals to find out how to set and require Centralized Addresses.

Below are examples of accepted UID's.

UID	Centralized Address
100	1-00
101	1-01
201	2-01
310	3-10
F99	15-99



---

Note: For backward compatibility Unit number in System can be represented by hexadecimal numbers couple in range 00-0F equal to decimal 00-15. For example 10A represents Centralized Address 1-15. We recommend not to use this option in future designs.



### 3 Commands Reference

#### 3.1 Cool Master Commands

Enter topic text here.

##### 3.1.1 alloff

**SYNOPSIS**

`alloff`

**DESCRIPTION**

Turn off all indoor units

**EXAMPLE**

```
>alloff  
OK
```

**EXIT CODE**

OK Request Successfully Executed

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9

##### 3.1.2 allon

**SYNOPSIS**

`allon`

**DESCRIPTION**

Turn on all indoor units.

**EXAMPLE**

```
>allon  
OK
```

**EXIT CODE**

OK Request Successfully Executed

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9



### 3.1.3 boot

#### SYNOPSIS

**boot**

#### DESCRIPTION

Switch CoolMaster to bootloader mode. Bootloader mode is used for Firmware Update. For details please see the [Firmware Update](#) section.

#### EXAMPLE

```
>boot  
reboot...
```

#### COMPATIBILITY

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9

### 3.1.4 cool

#### SYNOPSIS

**cool <UID>**

#### DESCRIPTION

Set indoor unit UID mode to COOL.

#### EXAMPLE

```
>cool 102  
OK
```

#### EXIT CODE

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

#### COMPATIBILITY

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9

### 3.1.5 dry

#### SYNOPSIS

**dry <UID>**

#### DESCRIPTION

Set indoor unit UID mode to DRY.

#### EXAMPLE

```
>dry 102  
OK
```





**EXIT CODE**

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9

**3.1.6 heat**

**SYNOPSIS**

heat <UID>

**DESCRIPTION**

Set indoor unit UID mode to HEAT.

**EXAMPLE**

```
>heat 102  
OK
```

**EXIT CODE**

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9

**3.1.7 fan**

**SYNOPSIS**

fan <UID>

**DESCRIPTION**

Set indoor unit UID mode to FAN.

**EXAMPLE**

```
>fan 102  
OK
```

**EXIT CODE**

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9



### 3.1.8 filt

#### SYNOPSIS

**filt <UID>**

#### DESCRIPTION

Reset filter sign on indoor unit UID.

#### EXAMPLE

```
>filt 102  
OK
```

#### EXIT CODE

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

#### COMPATIBILITY

CoolMaster 1000D v 0.3.1  
CoolMaster 2000S v 2.0.9

### 3.1.9 fspeed

#### SYNOPSIS

**fspeed <UID> <l|m|h|a>**

#### DESCRIPTION

Set indoor unit UID fan speed to low, medium, high, auto.

#### EXAMPLE

```
>fspeed 101 l Set unit 1-01 fan speed to low  
OK  
>fspeed 101 m Set unit 1-01 fan speed to medium  
OK  
>fspeed 101 h Set unit 1-01 fan speed to high  
OK  
>fspeed 101 a Set unit 1-01 fan speed to auto  
OK
```

#### EXIT CODE

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

#### COMPATIBILITY

CoolMaster 1000D v 0.3.0 Only l and h options supported  
CoolMaster 2000S v 2.0.9

### 3.1.10 off

#### SYNOPSIS

**offl <UID>**

**DESCRIPTION**

Turn off indoor unit UID.

**EXAMPLE**

```
>off 102
OK
```

**EXIT CODE**

OK Request Successfully Executed  
 ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
 CoolMaster 2000S v 2.0.9

**3.1.11 on****SYNOPSIS**

**on <UID>**

**DESCRIPTION**

Turn on indoor unit UID.

**EXAMPLE**

```
>on 102
OK
```

**EXIT CODE**

OK Request Successfully Executed  
 ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
 CoolMaster 2000S v 2.0.9

**3.1.12 set****SYNOPSIS**

**set [<option> <value>]**

**DESCRIPTION**

Query or set CoolMaster configuration. Without parameters set command will list all supported configuration options and their values. To change option use format with option and value. Some options are read only and can not be changed.

Configuration Option	Access Mode	Description
S/N	Read	CoolMaster Unit Serial Number
myid	R/W	CoolMaster Unit own Centralized Address



version	Read	Firmware Version
echo	R/W	0-Disable 1-Enable Commands echo
lcd	R/W	LCD size
simul	R/W	Number of Indoor units permanently simulated. If simul is not zero CoolMaster will simulate given number of units after reset.
CS count	Read	Check Sum errors counter
TO count	Read	Timeout errors counter

**EXAMPLE**

```

S/N      : 0041      Query configuration
myid    : 0A
version : 2.1.4
echo    : 1
lcd     : 8
simul   : 0
CS count: 0
TO count: 0
OK
>set echo 0      Set echo option (disable echo)
OK

```

**EXIT CODE**

OK Request Successfully Executed

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9

**3.1.13 simul****SYNOPSIS**

**simul <N>**

**DESCRIPTION**

Simulate N indoor units. Simulation mode can be used to debug Home Automation Controller software without connecting CoolMaster to Air Conditioning system line. To exit simulation mode set N to zero or restart CoolMaster.

**EXAMPLE**

```

>simul 20      Simulate 20 Indoor Units
OK
>simul 0      Terminate simulation mode
OK

```

**EXIT CODE**

OK Request Successfully Executed

**COMPATIBILITY**

CoolMaster 1000D v 0.3.0  
CoolMaster 2000S v 2.0.9



### 3.1.14 stat

#### SYNOPSIS

stat [UID]

#### DESCRIPTION

Get Indoor unit(s) status. Specific indoor unit can be addressed by UID. If no UID provided in request, response will contain information about all units

#### EXAMPLE

```
>stat
100 ON 12C 12,41C High Cool OK
101 OFF 32C 04,93C Low Dry OK
102 ON 07C 08,27C High Dry OK
103 OFF 01C 26,84C Med Dry OK
104 ON 04C 24,08C High Dry OK
105 OFF 11C 07,23C Low Dry OK
106 ON 11C 14,91C Auto Dry OK
107 ON 27C 12,94C Med Cool OK
OK
>stat 101
101 OFF 32C 04,93C Low Dry OK
OK
```

#### RESPONSE

Position in String	Example	Format	Description
0-2	109	NNN	Indoor unit Centralized Address
4-6	ON	ON or OFF	On/Off Status
8-10	23C	NNC	Set Temperature °C
12-17	24,08C	NN,NNC	Room Temperature °C
20-23	Auto	Low or Med or High or Auto	Fan Speed
25-28	Cool	Cool or Heat or Fan or Dry	Operation Mode
30-32	OK	OK or XN	OK or Failure code

#### EXIT CODE

OK Request Successfully Executed  
 ERROR:1 Unit with specified UID not found

#### COMPATIBILITY

CoolMaster 1000D v 0.0.1

CoolMaster 2000S v 2.0.9

This command is obsolete and is supported only for backward compatibility.

### 3.1.15 stat2

#### SYNOPSIS

stat2 [UID]

#### DESCRIPTION

Get Indoor unit(s) status. Specific indoor unit can be addressed by UID. If no UID provided in request, response will contain information about all units. stat2 compared to stat1 has additional Filter Reset Sign indication

**EXAMPLE**

```

>stat2
100 ON 12C 12,41C High Cool OK 0
101 OFF 32C 04,93C Low Dry OK 1
102 ON 07C 08,27C High Dry OK 0
103 OFF 01C 26,84C Med Dry OK 0
104 ON 04C 24,08C High Dry OK 0
105 OFF 11C 07,23C Low Dry OK 0
106 ON 11C 14,91C Auto Dry OK 0
107 ON 27C 12,94C Med Cool OK 1
OK
>stat2 101
101 OFF 32C 04,93C Low Dry OK 0
OK

```

**RESPONSE**

<u>Position in String</u>	<u>Example</u>	<u>Format</u>	<u>Description</u>
0-2	109	NNN	Indoor unit Centralized Address
4-6	ON	ON or OFF	On/Off Status
8-10	23C	NNC	Set Temperature °C
12-17	24,08C	NN,NNC	Room Temperature °C
20-23	Auto	Low or Med or High or Auto	Fan Speed
25-28	Cool	Cool or Heat or Fan or Dry	Operation Mode
30-32	OK	OK or XN	OK or Failure code
34	0	0 or 1	Filter Reset Sign present

**EXIT CODE**

OK Request Successfully Executed  
 ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 0.3.1  
 CoolMaster 2000S v 2.0.9

**3.1.16 stat3****SYNOPSIS**

**stat3 [UID]**

**DESCRIPTION**

Get Indoor unit(s) status. Specific indoor unit can be addressed by UID. If no UID provided in request, response will contain information about all units. stat3 compared to stat2 has no fractional part in the room temperature presentation.

**EXAMPLE**

```

>stat3
100 ON 12C 12C High Cool OK 0
101 OFF 32C 04C Low Dry OK 1
102 ON 07C 08C High Dry OK 0
103 OFF 01C 26C Med Dry OK 0
104 ON 04C 24C High Dry OK 0

```



```

105 OFF 11C 07C Low Dry OK 0
106 ON 11C 14C Auto Dry OK 0
107 ON 27C 12C Med Cool OK 1
OK
>stat3 101
101 OFF 32C 04C Low Dry OK 0
OK

```

**RESPONSE**

<u>Position in String</u>	<u>Example</u>	<u>Format</u>	<u>Description</u>
0-2	109	NNN	Indoor unit Centralized Address
4-6	ON	ON or OFF	On/Off Status
8-10	23C	NNC	Set Temperature °C
12-14	24C	NNC	Room Temperature °C
16-19	Auto	Low or Med or High or Auto	Fan Speed
21-24	Cool	Cool or Heat or Fan or Dry	Operation Mode
26-27	OK	OK or XN	OK or Failure code
29	0	0 or 1	Filter Reset Sign present

**EXIT CODE**

OK Request Successfully Executed  
 ERROR:1 Unit with specified UID not found

**COMPATIBILITY**

CoolMaster 1000D v 2.0.9  
 CoolMaster 2000S v 2.0.9

**3.1.17 swing****SYNOPSIS**

**swing <UID> <a|h|3|4|6|v>**

**DESCRIPTION**

Set indoor unit <UID> swing to auto, horizontal, 30°, 45°, 60° or vertical. Not all indoor unit types support swing.

**EXAMPLE**

```

>swing 101 a      Set unit 1-01 swing to auto
OK
>swing 101 h      Set unit 1-01 swing to horizontal
OK
>swing 101 3      Set unit 1-01 swing to 30°
OK
>swing 101 4      Set unit 1-01 swing to 45°
OK
>swing 101 6      Set unit 1-01 swing to 60°
OK
>swing 101 v      Set unit 1-01 swing to vertical
OK

```

**EXIT CODE**



OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

#### COMPATIBILITY

CoolMaster 1000D N.A.  
CoolMaster 2000S v2.3.1  
CoolMaster 3000T v2.3.1  
CoolMaster 4000M v2.3.1

### 3.1.18 temp

#### SYNOPSIS

**temp <UID> [±]<TEMPERATURE>**

#### DESCRIPTION

Set indoor unit temperature. <TEMPERATURE> parameter must be decimal number. Command can work in relative or absolute manner. If plus '+' or minus '-' sign precede <TEMPERATURE> parameter it's value will be used as requested delta. It means the set temperature will be increased (+) or decreased (-) to that delta. Otherwise temperature will be set to the given value.

#### EXAMPLE

```
>temp 101 20      Set unit 1-01 temperature to 20°C  
OK  
>temp 101 -1     Decrease unit 1-01 temperature by 1°C  
OK  
>temp 101 +3     Increase unit 1-01 temperature by 3°C  
OK
```

#### EXIT CODE

OK Request Successfully Executed  
ERROR:1 Unit with specified UID not found

#### COMPATIBILITY

CoolMaster 1000D v 2.0.9  
CoolMaster 2000S v 2.0.9




## 4 Firmware Update

### 4.1 Entering bootloader mode

The process of updating CoolMaster's firmware is very simple and straightforward. First of all CoolMaster has be switched into bootloader mode. In order to do so, please connect your PC (Laptop) to the RS232 port of the CoolMaster. Next open the Hyper Terminal program and run [boot](#) command. This process is described in "User Manual" document. At this point "BOOT" message should appear on the LCD screen of the CoolMaster. Now it is ready for firmware uploading. Please close Hyper Terminal program and follow to the next step - [Firmware Download](#).

If for some reason CoolMaster is not responding to boot command or preceding firmware update has failed and CoolMaster is not functioning at all, follow the next steps in order to enter bootloader mode.

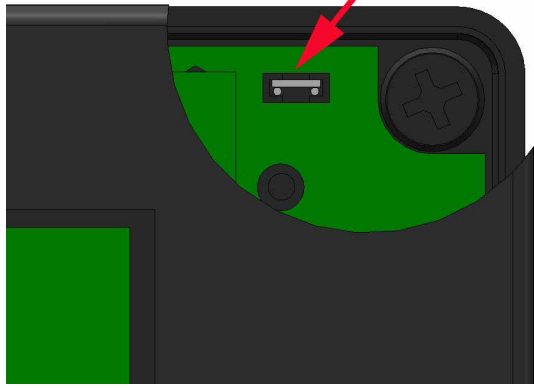Step1	Disconnect power supply from the CoolMaster	
Step2	Open CoolMaster top cover	
Step3	Open BOOT jumper shown on the diagram	
Step4	Connect power supply to CoolMaster	

### 4.2 Firmware Download

Firmware update is supplied as a set of BAT file(s) and firmware image(s). BAT file can be for example `progp-DAIKIN.bat` and corresponding image file `DAIKIN.INC`. Make sure that BAT file and the image file are located in same directory. In order to start the process, please simply run the BAT file.

After running BAT file, the ComPort selection prompt will appear and the correct port number should be entered in order to proceed.

```

E:\xol@work /home/xol/work/D3net/gen2/rel/2.3.8
work xol <~/work/D3net/gen2/rel/2.3.8>
<> ./progp-DAIKIN-COOLGATE.bat
ComPort: 1

c:\XOL\D3net\gen2\rel\2.3.8>mode COM1 BAUD=9600 DATA=8 STOP=1 PARITY=n to=off xo
n=off odsr=off octs=off dtr=off rts=off idsr=off

Status for device COM1:
-----
Baud:          9600
Parity:        None
Data Bits:     8
Stop Bits:     1
Timeout:       OFF
XON/XOFF:      OFF
CTS handshaking: OFF
DSR handshaking: OFF
DSR sensitivity: OFF
DTR circuit:   OFF
RTS circuit:   OFF

c:\XOL\D3net\gen2\rel\2.3.8>type DAIKIN-COOLGATE.INC 1>COM1
-
    
```

CoolMaster will react with running address counter on its LCD screen. The whole process may take about a few minutes, and it ends with "EOF" and shortly afterwards "READY" messages on the LCD screen.

### 4.3 Reboot

After firmware downloading has being finished you need to power reset CoolMaster. If it was entered bootloader mode with BOOT jumper, please make sure to close BOOT jumper back before power reset.

# Index

## - A -

AirNet 14

## - B -

boot 8

## - C -

cool 7, 8

## - D -

dry 8

## - F -

fan 9, 10

filt 10

Filter Sign 10, 13, 14

## - H -

heat 9

## - O -

off 10

on 11

## - S -

set 11

simul 12

stat 13

stat2 13

stat3 14

swing 15